


NOTE: PLEASE SEE SECTION 2668 FOR PLACEMENT LOCATION.

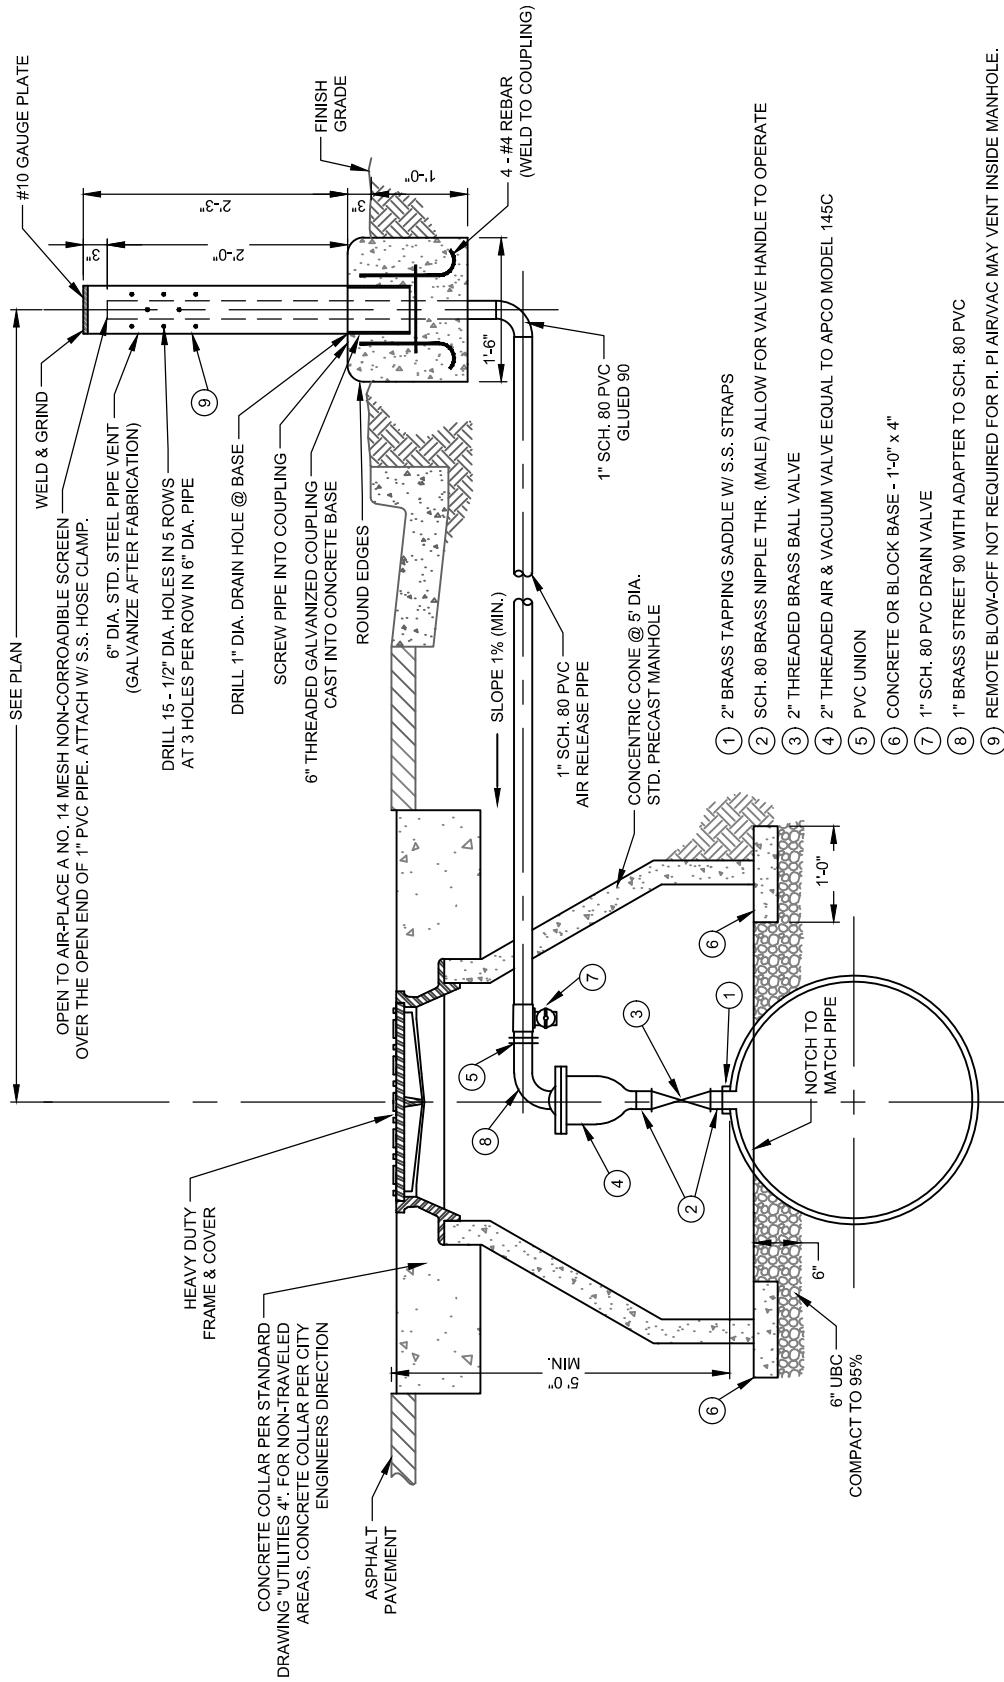

- ① 2" BRASS TAPPING SADDLE W/ S.S. STRAPS
- ② SCH. 80 BRASS NIPPLE THR. (MALE) ALLOW FOR VALVE HANDLE TO OPERATE
- ③ 2" THREADED BRASS BALL VALVE
- ④ 2" THREADED AIR & VACUUM VALVE EQUAL TO APCO MODEL 145C
- ⑤ PVC UNION
- ⑥ CONCRETE OR BLOCK BASE - 1'-0" x 4"
- ⑦ 1" SCH. 80 PVC DRAIN VALVE
- ⑧ 1" BRASS STREET 90 WITH ADAPTER TO SCH. 80 PVC
- ⑨ REMOTE BLOW-OFF NOT REQUIRED FOR PI. PI/AIRVAC MAY VENT INSIDE MANHOLE.

AIR/VAC RELEASE STATION


HORROCKS ENGINEERS

728 WEST 100 SOUTH #2
HEBER CITY, UTAH 84032
(435) 654-2226

DATE: FEBRUARY 2019

SCALE: N.T.S.

75 NORTH MAIN STREET
HEBER CITY, UTAH 84032
(435) 654-0757



HEBER CITY STANDARD DRAWING

WATER-7